



**VENTILATION BOX DETAIL**  
(NTS)

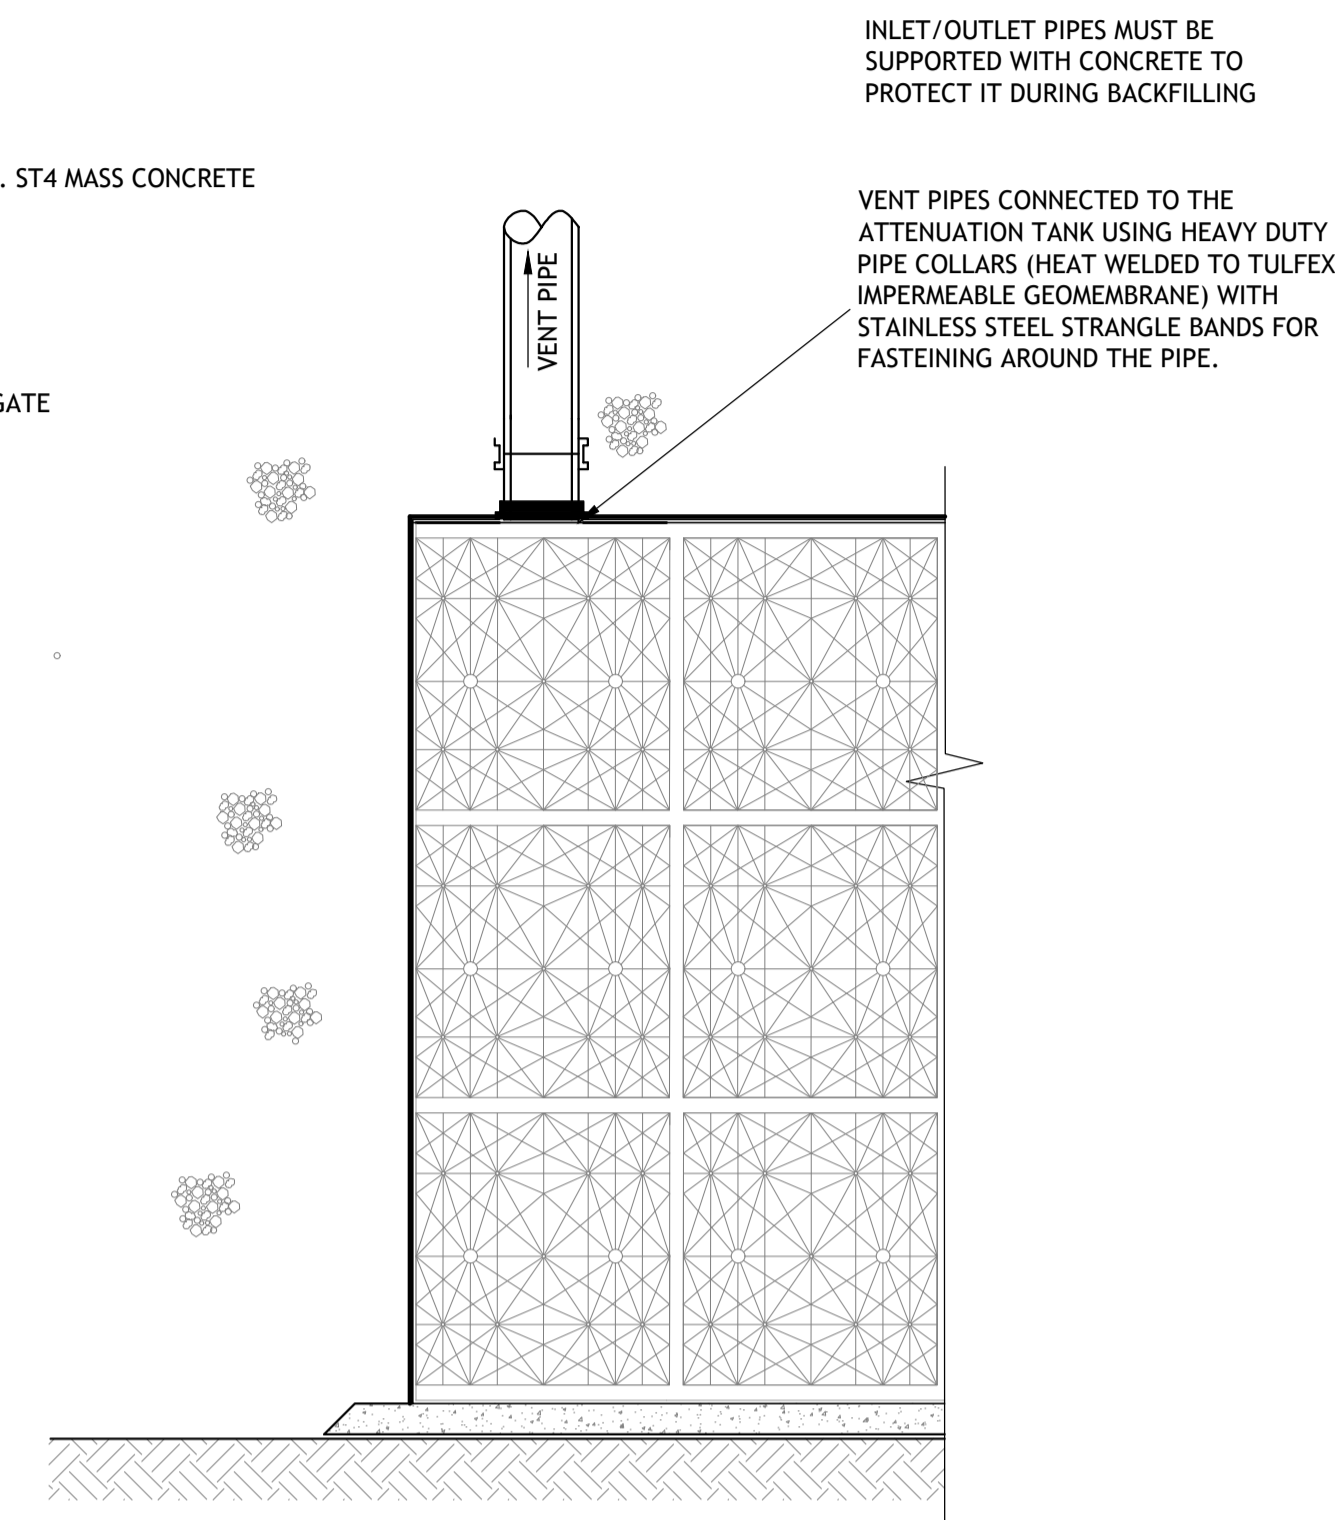


**TYPICAL 1600 VENT/ACPIPE CONNECTION**  
1:100

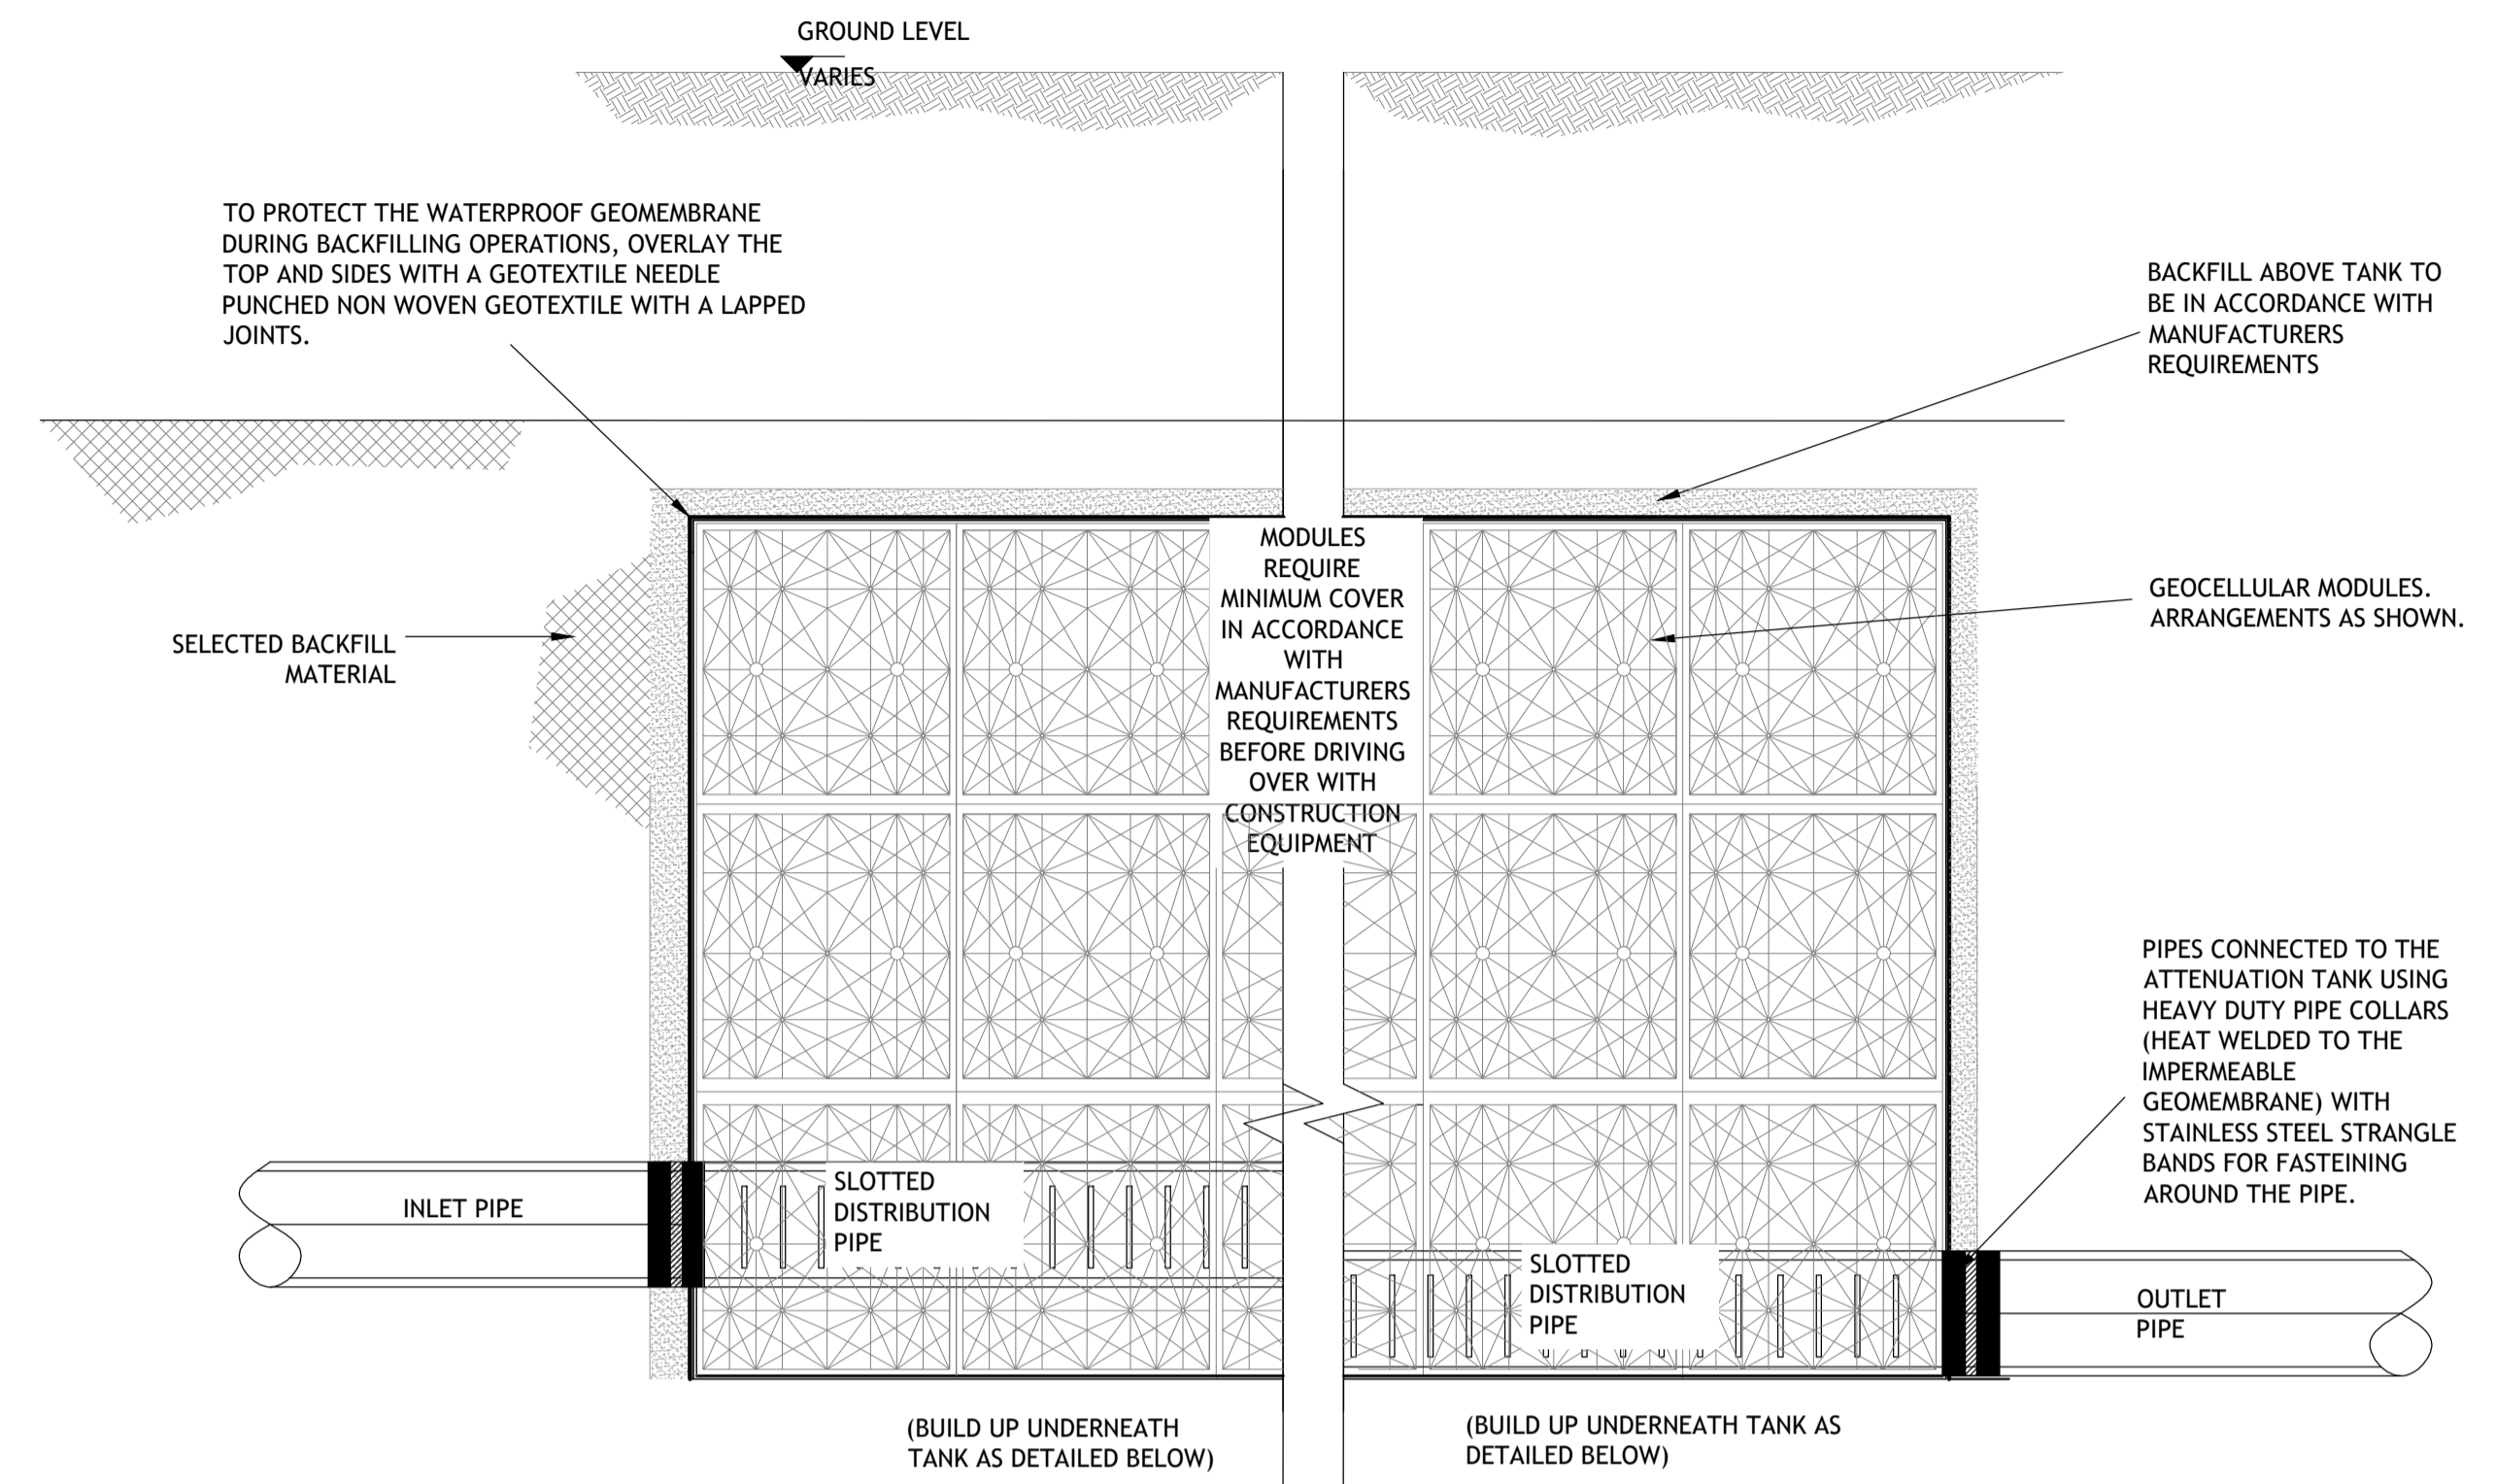

**TYPICAL INLET PIPE CONNECTION** NTS  
**TYPICAL OUTLET PIPE CONNECTION** NTS

**TYPICAL DETAILS OF ATTENUATION TANK USING GEOCELLULAR MODULAR UNITS (SIDE VIEW)**  
NTS

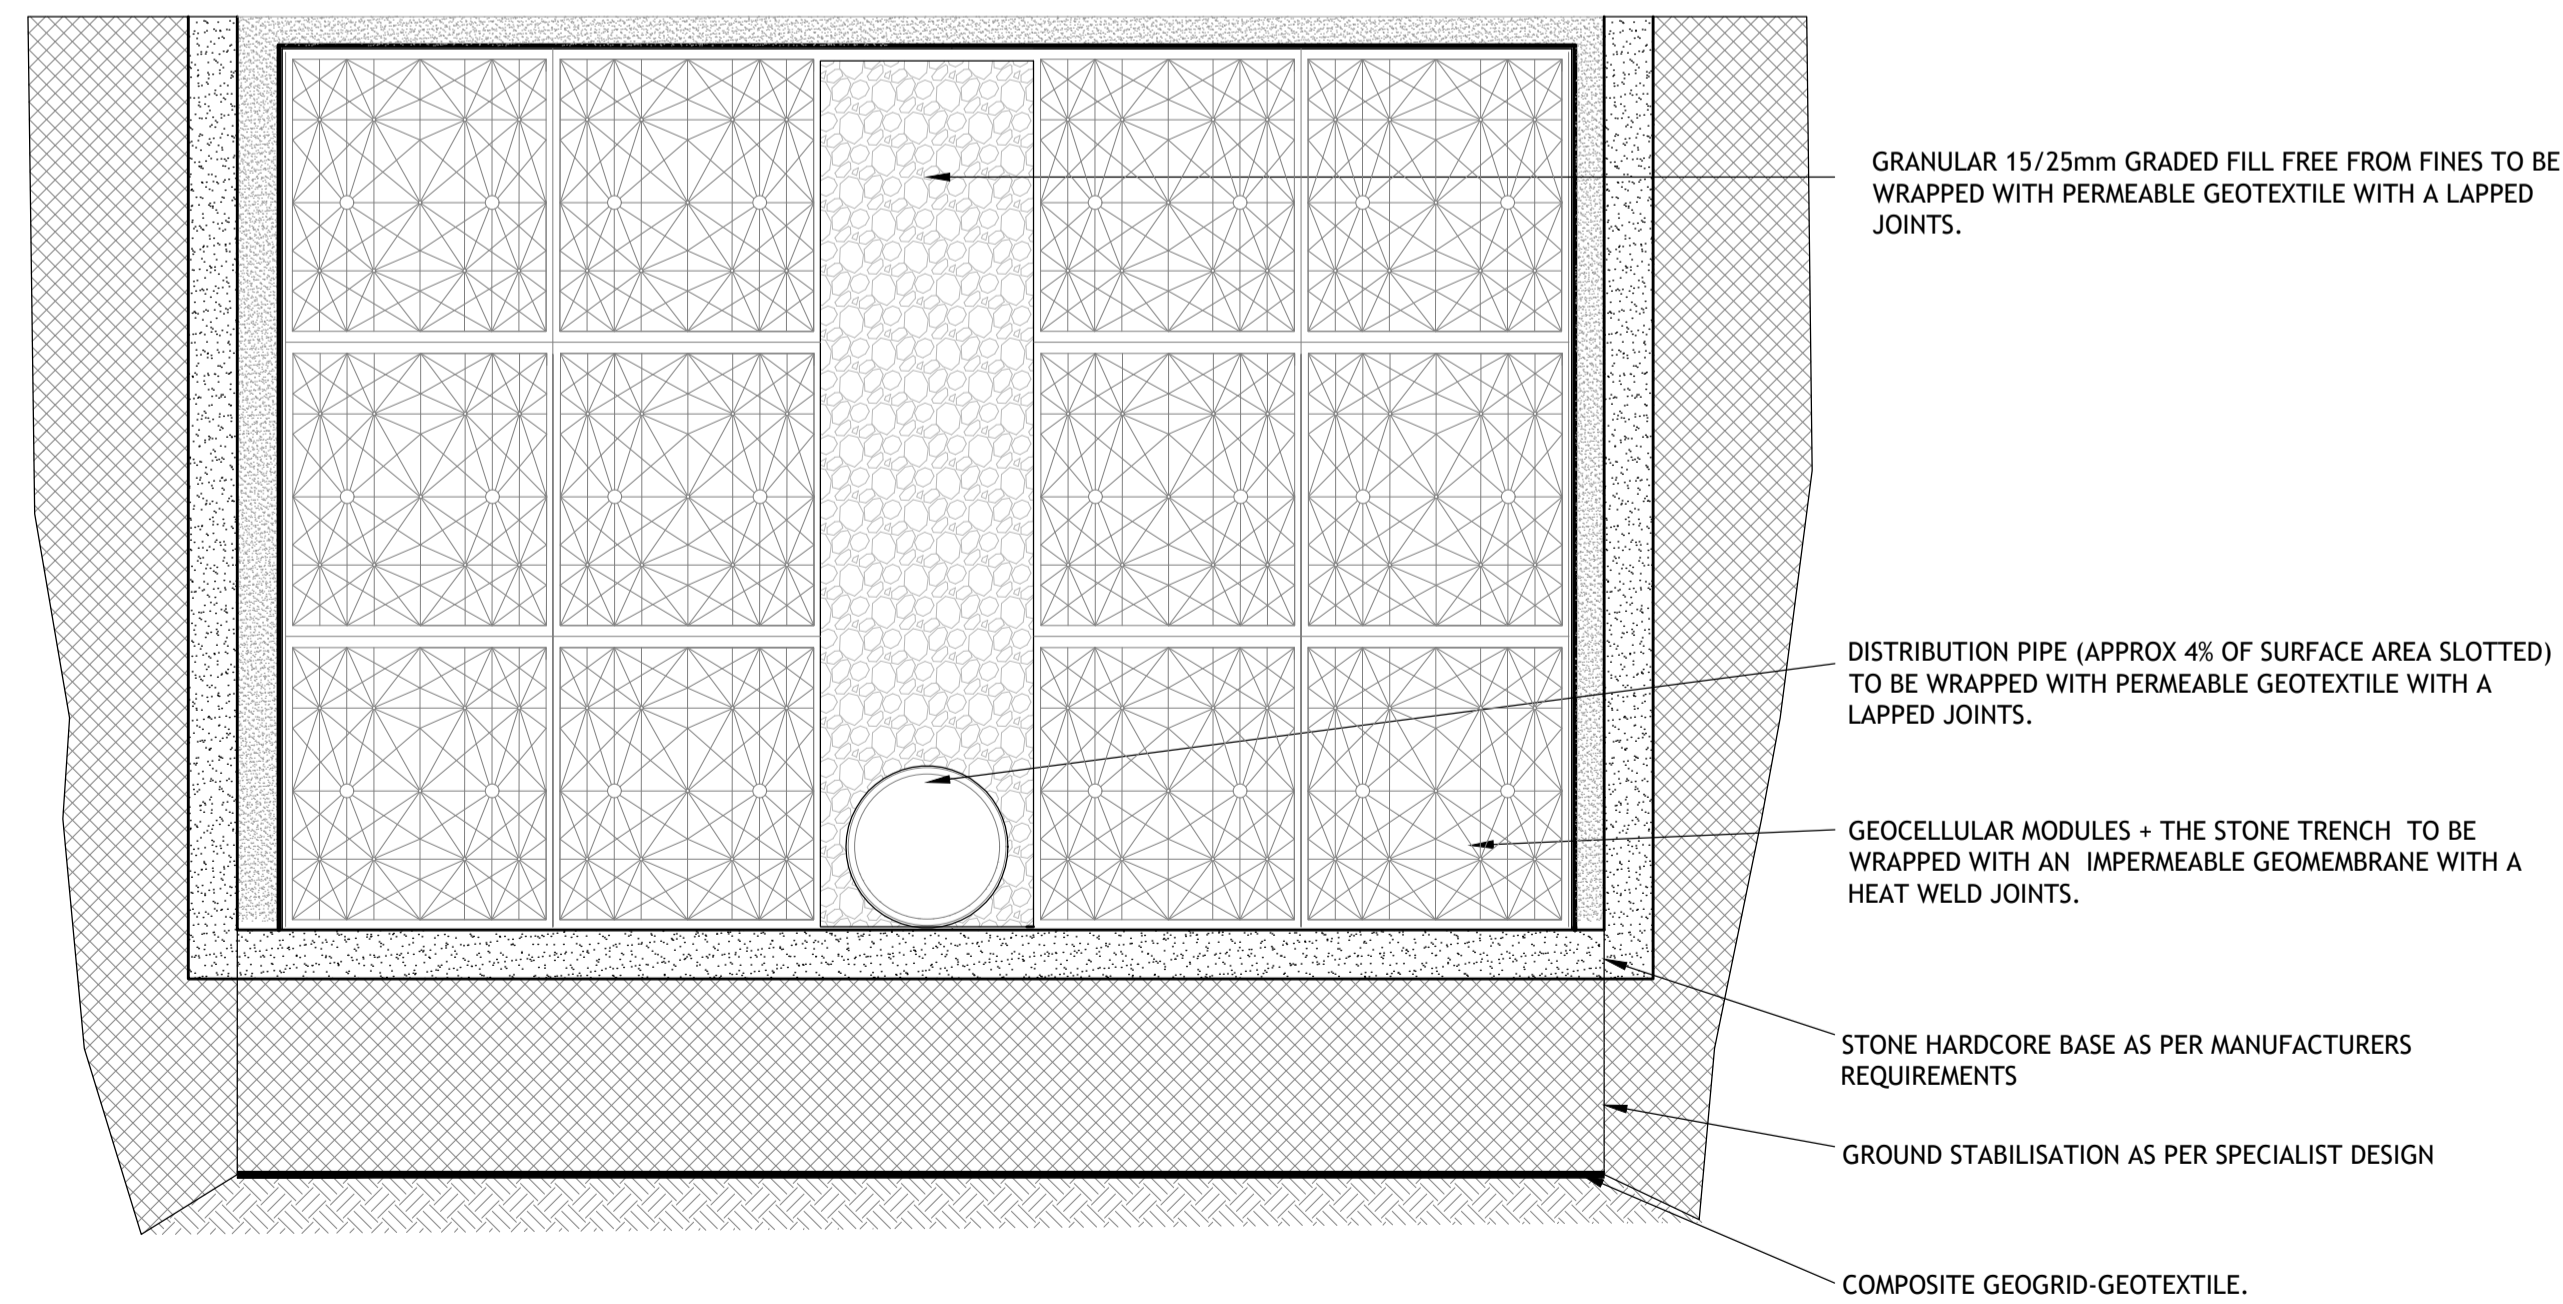

**TYPICAL DETAILS OF ATTENUATION TANK USING GEOCELLULAR MODULAR UNITS (FRONT VIEW)**  
NTS

NOTE:  
REFER TO DRAINAGE DRAWING 192115-001 FOR TANKS LOCATIONS.

A 3 - 5% CBR HAS BEEN ASSUMED AT SUB-BASE LEVEL SHOULD THE CBR BE TESTED AND FOUND TO BE LESS THAN 3% THEN THE ENGINEER SHALL BE NOTIFIED. ALSO, ANY SOFT SPOTS FOUND AT SUB-BASE LEVEL SHALL BE REPORTED TO THE ENGINEER

NOTE:  
SHOWN DETAILS ARE TYPICAL. CONTRACTOR TO REFER TO MANUFACTURERS DETAILS & REQUIREMENTS FOR PROJECT SPECIFIC INFORMATION & DETAILS.

THE CONTRACTOR SHALL PROHIBIT THE MOVEMENT OF CONSTRUCTION PLANT ACROSS THE STORAGE TANK AND WHERE NECESSARY PROVIDE ADDITIONAL SUPPORT AND PROTECTION TO THE STRUCTURE. PARTICULARLY POST CONSTRUCTION. TEMPORARY FENCING CAN BE USED TO PROHIBIT TRADE STOCKS, PILLING MATERIALS, HEAVY PLANTS ETC.,